

1 CLEVIS/SPOOL* INSTALLED
 PERMANENTLY 6 INCHES FROM THE TOP
 OF THE POLE
 (* OBTAIN FROM DES)

WEATHERHEAD REQUIRED WITH 18" OF WIRE

16 FOOT TREATED POLE OR A TREATED
 TIMBER, MINIMUM SIZE 6" X 6". (SMALLER
 SIZE TIMBERS WILL NOT BE ACCEPTED.)
 POLE MUST BE 4 FOOT BELOW AND 12 FOOT
 ABOVE GROUND LEVEL.

A ROUND POLE WITH A MINIMUM DIAMETER
 OF 6" IS ACCEPTABLE

PVC. CONDUIT OR METAL
 CONDUIT REQUIRED WITH
 A MINIMUM OF 2 CONDUIT STRAPS

UL LISTED DES APPROVED
 METER BASE
 FURNISHED AND INSTALLED BY
 CUSTOMER OR CONTRACTOR


WEATHERPROOF SERVICE PANEL.
 ALL RECEPTACLES SHALL
 HAVE GROUND FAULT CIRCUIT
 INTERRUPTER PROTECTION FOR
 PERSONNEL AND SHALL BE
 WEATHERPROOF.

GROUNDING PER NEC

APPROVED GROUNDING ELECTRODE

GROUND LEVEL

BACK FILL MUST BE
 FIRMLY TAMPED
 POLE MAY NEED TO
 BE BRACED OR GUYED

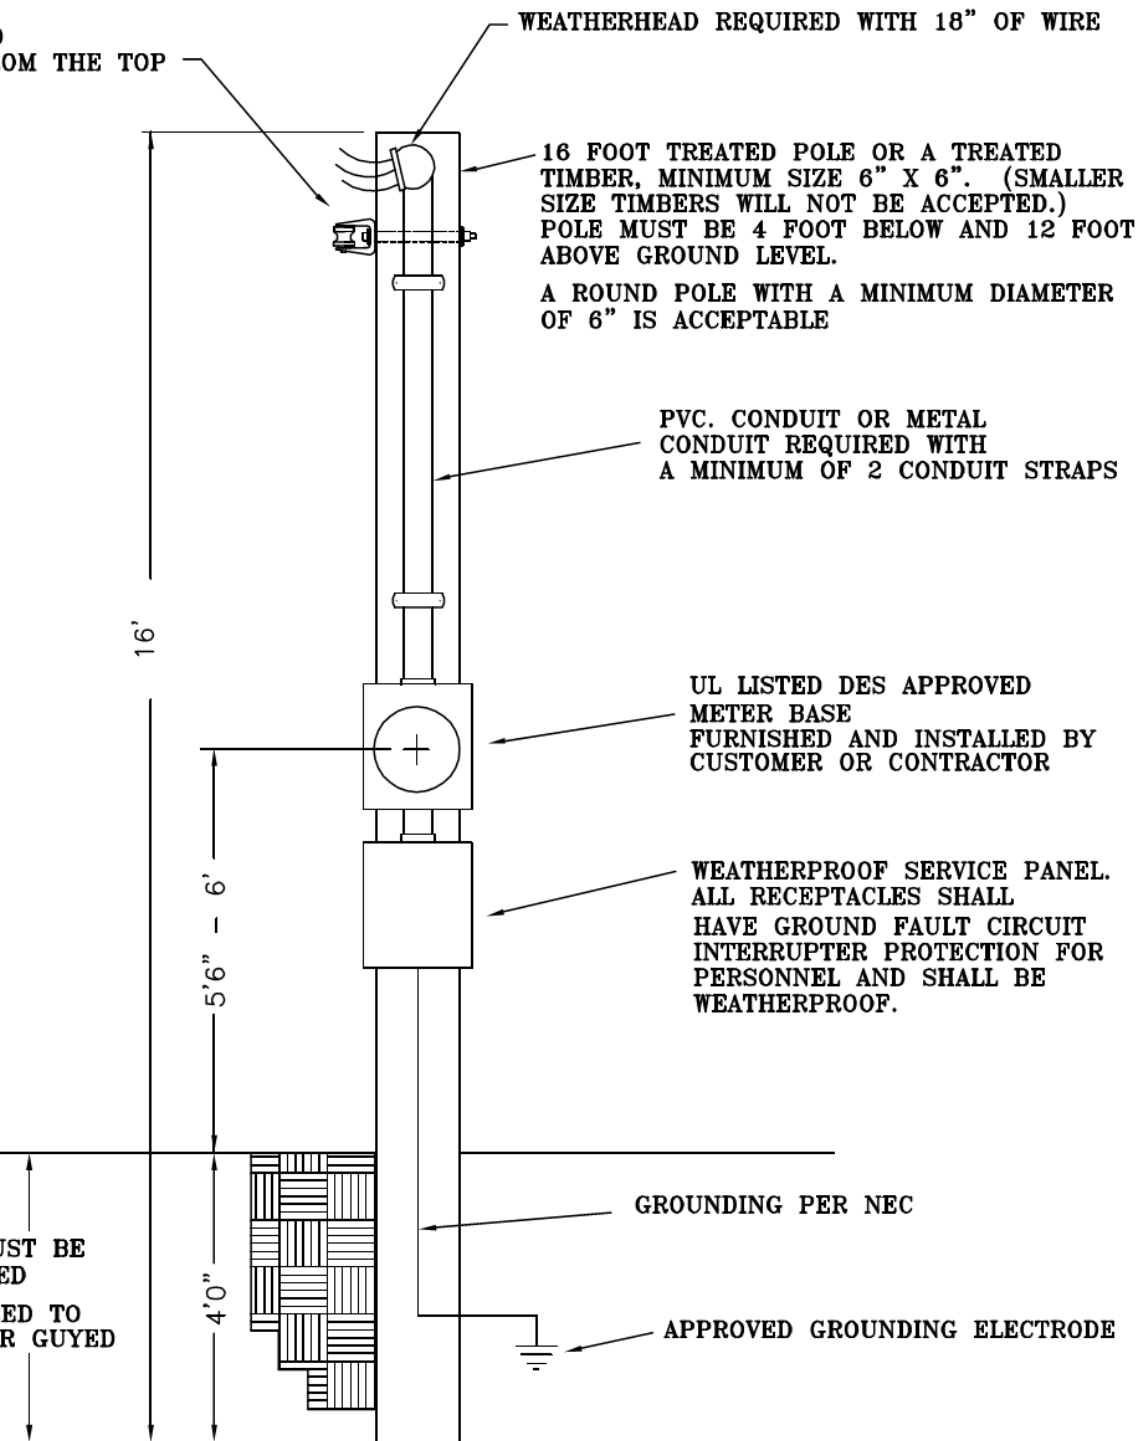

NOTES:

1. ALL WIRING SHALL COMPLY WITH THE STATE AND NATIONAL ELECTRICAL CODES.
2. DES ENGINEERING MUST SPOT TEMPORARY SERVICE POLE LOCATION PRIOR TO TEMPORARY SERVICE POLE INSTALLATION
3. SPECIAL CONDITIONS MAY REQUIRE ADDITIONAL SERVICE WIRE CLEARANCES
 THIS IS NOT ACCEPTABLE FOR MOBILE HOMES.



DYERSBURG ELECTRIC
 SYSTEM

CONSTRUCTION TEMPORARY
 POLE OR "RV" POLE